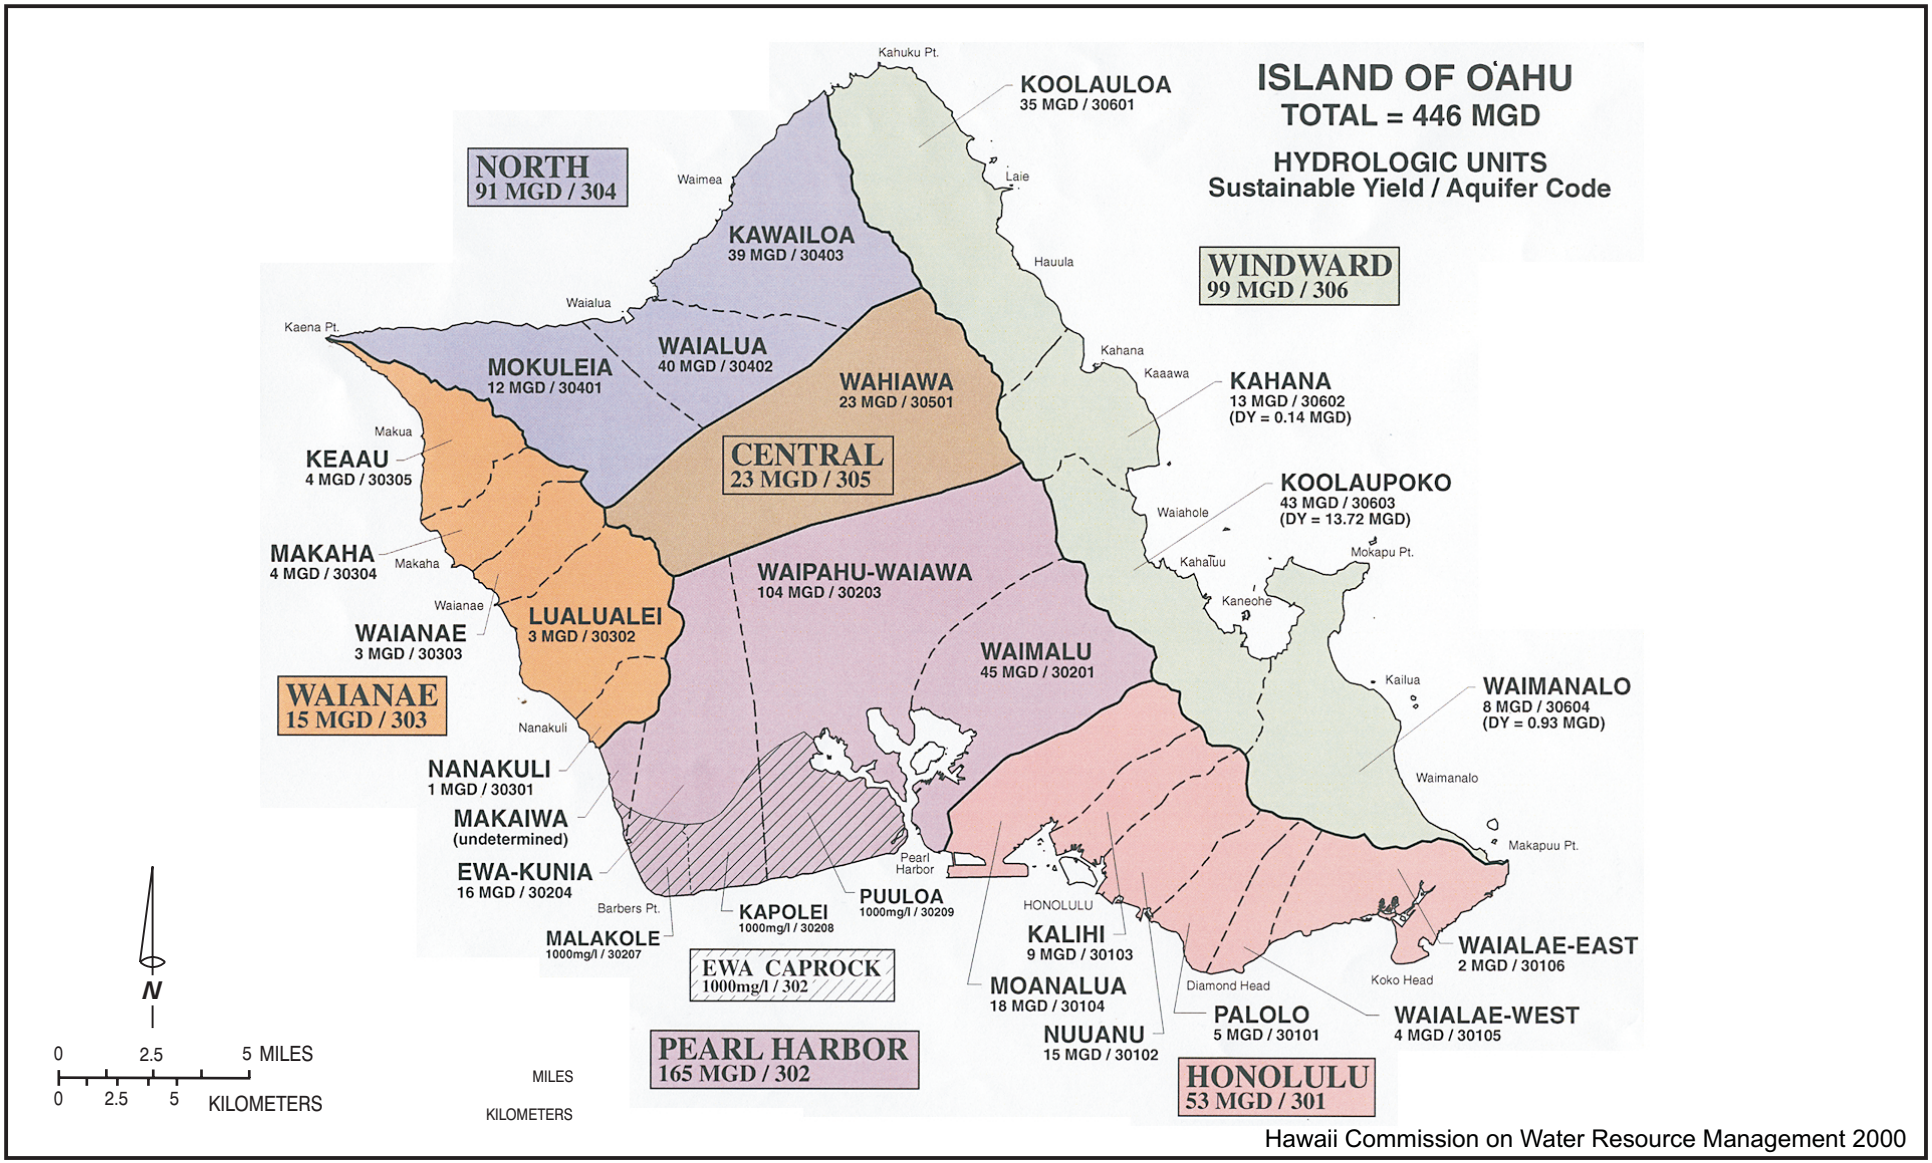

Hawaii Commission on Water Resource Management 2000

R:\new\J397\Figure_3s&4s\Figure_3-8.cdr - 04/10/03 - CT

Ninety percent of the fresh water used on O'ahu in 1980 was groundwater.

Legend

Ewa Caprock overlying 30205 & 30203 basal acquifer systems

DY - Developable Yield

Groundwater Hydrologic Units and Estimated Sustainable Yields on O'ahu

O'ahu, Hawai'i

Figure 3-8